
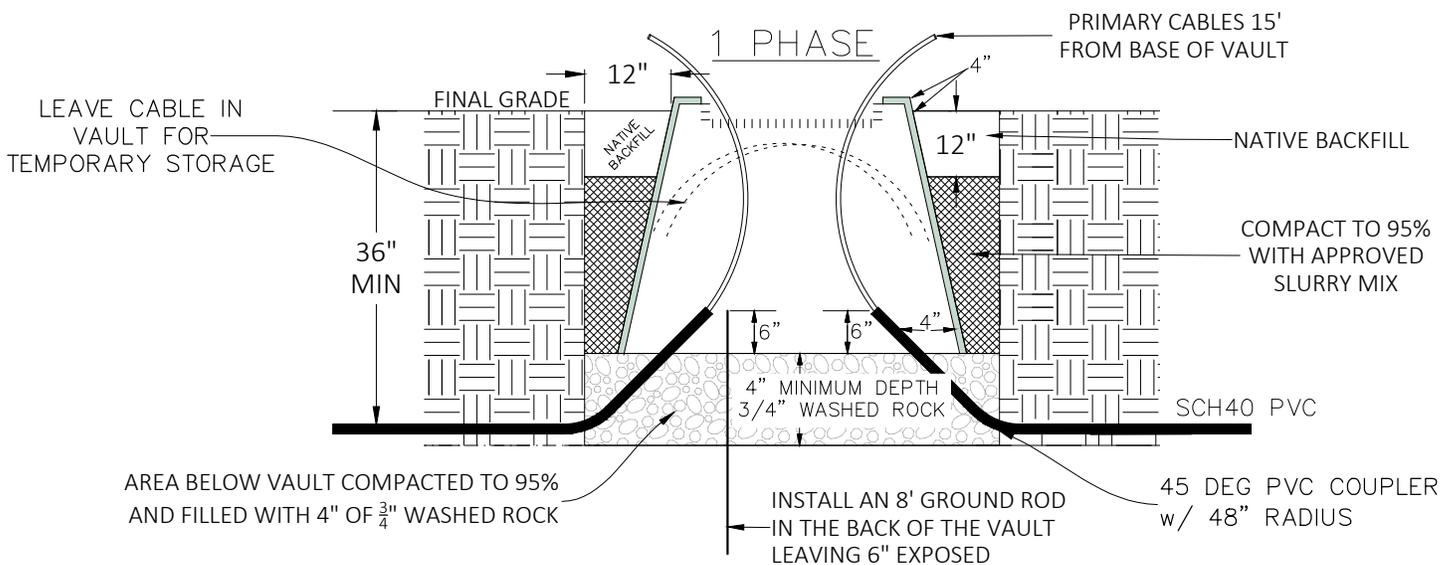


PROFILE VIEW

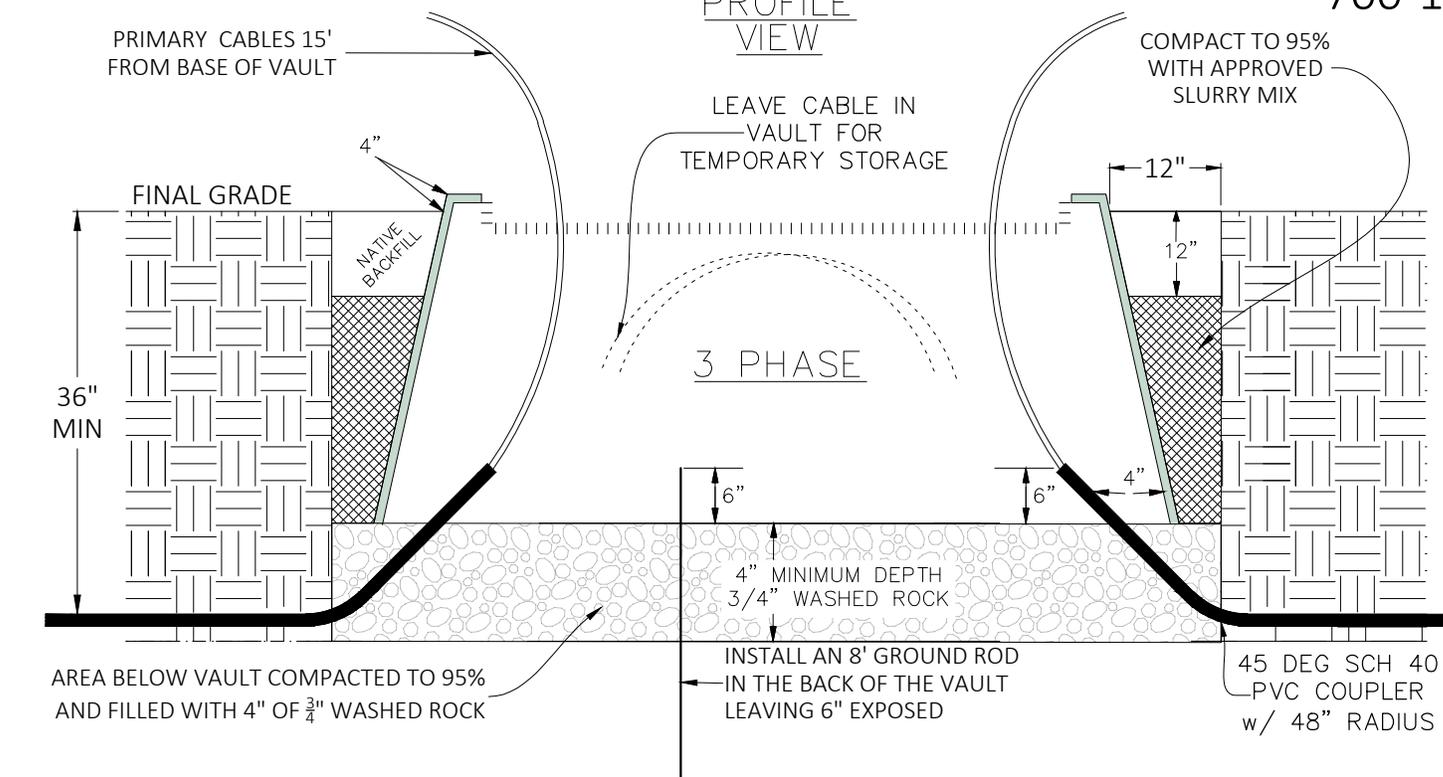

NOTES:

1. VAULT MUST BE LEVEL AND SET 4" ABOVE FINAL GRADE
2. PROVIDE 95% COMPACTION UNDER AND AROUND THE VAULT
3. MINIMUM OF 4" WASHED ROCK TO BE INSTALLED UNDER THE VAULT
4. CABLE LENGTH SHALL BE 15' AND MEASURED FROM THE BASE OF THE VAULT
5. THE CABLE DUCT SHALL HAVE 6" EXPOSED IN THE VAULT
6. USE 45 DEG COUPLERS w/ 48 IN RADIUS TO SWEEP THE PRIMARY PVC CONDUITS INTO THE VAULT
7. AN 8' GROUND ROD SHALL BE PLACED IN THE BACK OF THE VAULT OPENING LEAVING 6" EXPOSED ABOVE THE ROCK
8. REFER TO DETAIL 700-02 FOR MINIMUM CLEARANCE REQUIREMENTS

ELECTRIC SERVICES

CALL 1-800-922-1987 TO OBTAIN UTILITY LOCATES

NOT TO SCALE



1100 S SHERMAN ST
LONGMONT, CO 80501

PRIMARY JUNCTION VAULT

PHONE: 303-651-8386
FAX: 303-651-8796

Revision #:
Approved by:
Date Approved:
File: UG Drawings 2025
DETAIL
700-11