


ALL NON-CURRENT CARRYING METALLIC PARTS TO BE BONDED TO NEUTRAL AND EFFECTIVELY GROUNDED PER NEC

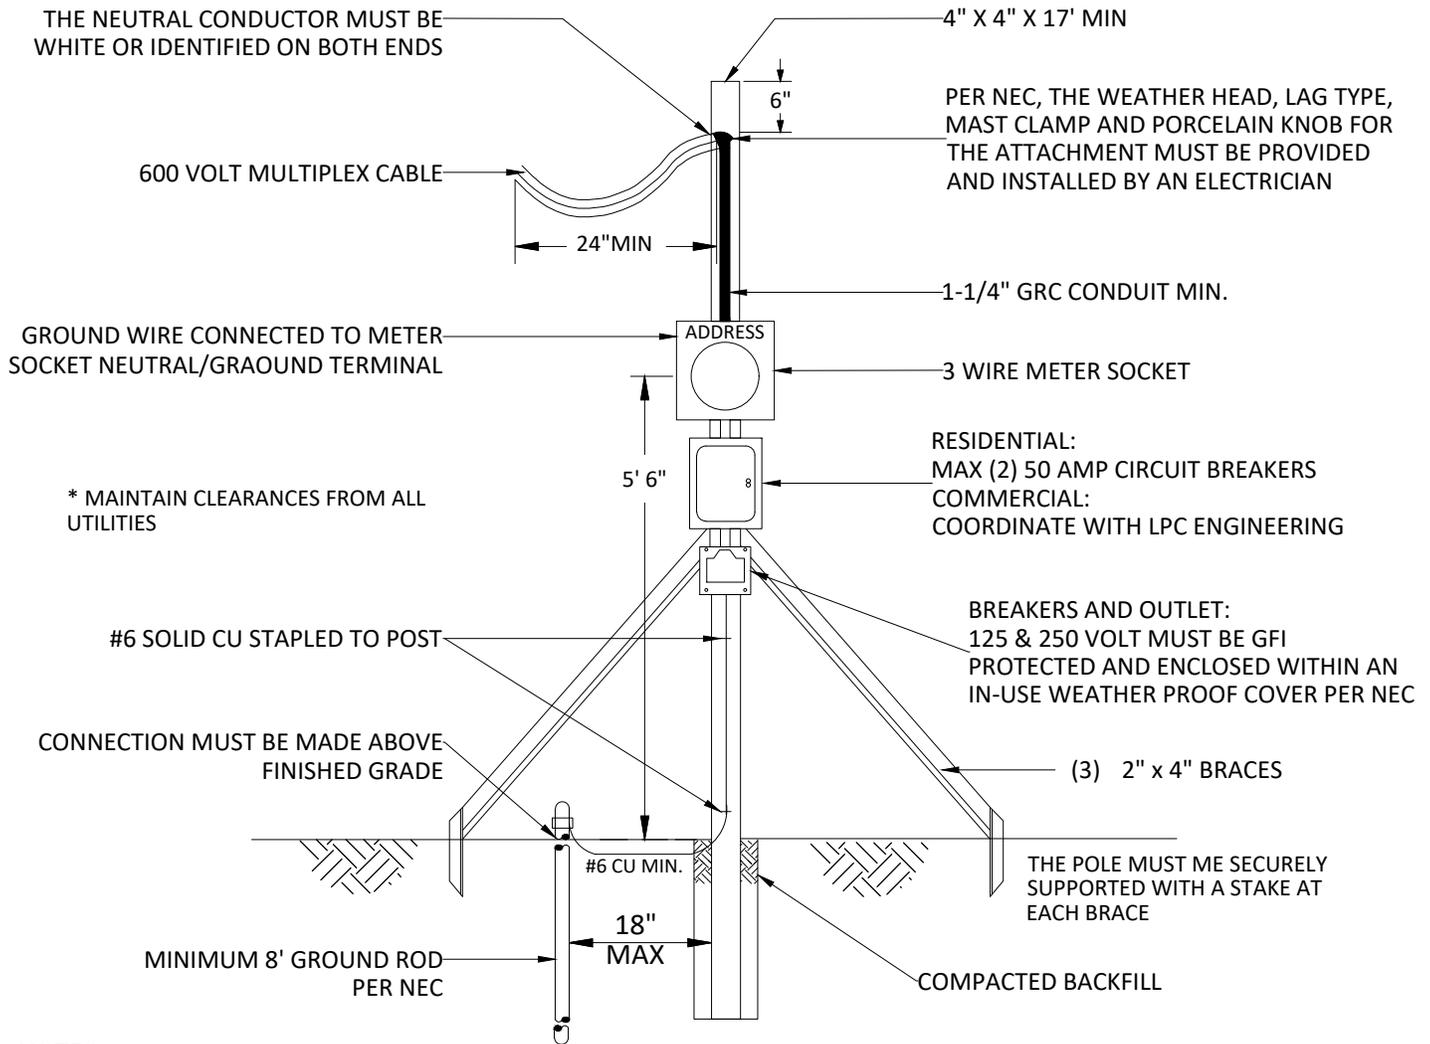

NOTES:

1. ALL CONNECTIONS TO CITY-OWNED FACILITIES MUST BE MADE BY CITY PERSONNEL
2. METER SOCKET AND BREAKER IS REQUIRED AND SHALL MEET NEC REQUIREMENTS PER SIZING OF SERVICE.
3. ALL EQUIPMENT SHALL BE FURNISHED AND INSTALLED BY THE CUSTOMER
4. COMMERCIAL TEMPORARY METERING SHALL FOLLOW THE NEC DISCONNECT GUIDELINES.
5. ALL SERVICES 400 AMPS OR LESS, REQUIRE A LEVER OPERATED BYPASS. REFER TO BYPASS DETAILS WITHIN MTR-14, MTR-16 AND MTR-17
6. SINGLE PHASE 120/208v TEMP POWER REQUIRES 5TH JAW AT 9 O'CLOCK POSITION IN METER HOUSING SOCKET
7. THE ADDRESS FOR TEMPORARY SERVICES MUST BE PROMINENTLY POSTED FOR SINGLE FAMILY RESIDENTIAL AND A PHENOLIC BADGE FOR COMMERCIAL.
8. REFER TO SECTION 703.01 FOR LABELING REQUIREMENTS
9. THIS METER WILL BE RELOCATED TO THE BUILDING STRUCTURE UPON FINAL RELEASE.
10. REFER TO SECTION 700 FOR ALL OTHER DETAILS

CALL 1-800-922-1987 TO OBTAIN UTILITY LOCATES

NOT TO SCALE

# TEMPORARY POWER OVERHEAD



1100 S SHERMAN ST  
LONGMONT, CO 80501

PHONE: 303-651-8386  
FAX: 303-651-8796

Revision #:
Approved by:
DATE APPROVED: 2025
File: MTR DRAWINGS_2025.dwg
<b>DETAIL</b>
<b>MTR-3</b>