


FOR EXTENDED STORAGE:

REELS SHOULD BE STORED CRADLED BETWEEN RAILROAD TIES, POWER POLES OR CROSS ARMS. SIZE AND SPACING OF THE SUPPORTS SHOULD RAISE THE FLANGE ABOVE THE GROUND. THIS HELPS KEEP THE FLANGES FROM DECAYING AND PREVENTS THE REELS FROM ROLLING.

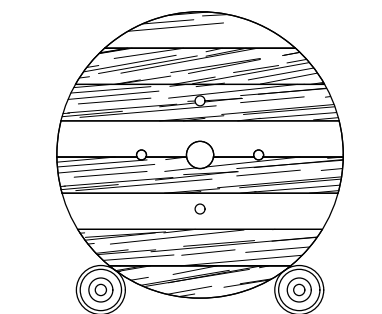

AT TEMPORARY STORAGE SITES WHERE SOIL MAY BE SOFT, PRESERVATIVE TREATED PLYWOOD SHEETS MAY BE USED TO KEEP REEL FLANGES FROM SINKING INTO THE GROUND.

TO PREVENT ENTRANCE OF WATER, CABLE ENDS SHOULD BE SEALED WITH PLASTIC END CAPS. ELECTRICAL TAPE DOES NOT OFFER A SUFFICIENT SEAL. WHEN LENGTHS ARE CUT, CABLE ENDS SHOULD BE IMMEDIATELY RESEALED AND SECURED.

REFER TO COLD SHRINK INSTALLATION DETAIL 700-08

ELECTRIC SERVICES

CALL 1-800-922-1987 TO OBTAIN UTILITY LOCATES

NOT TO SCALE



CITY OF
LONGMONT
COLORADO

1100 S SHERMAN ST
LONGMONT, CO 80501

**CABLE HANDLING AND
STORAGE PROCEDURES
(CONTINUED)**

PHONE: 303-651-8386
FAX: 303-651-8796

| |
|------------------------|
| Revision #: |
| Approved by: |
| Date Approved: |
| File: UG Drawings_2025 |
| DETAIL |
| 700-07B |