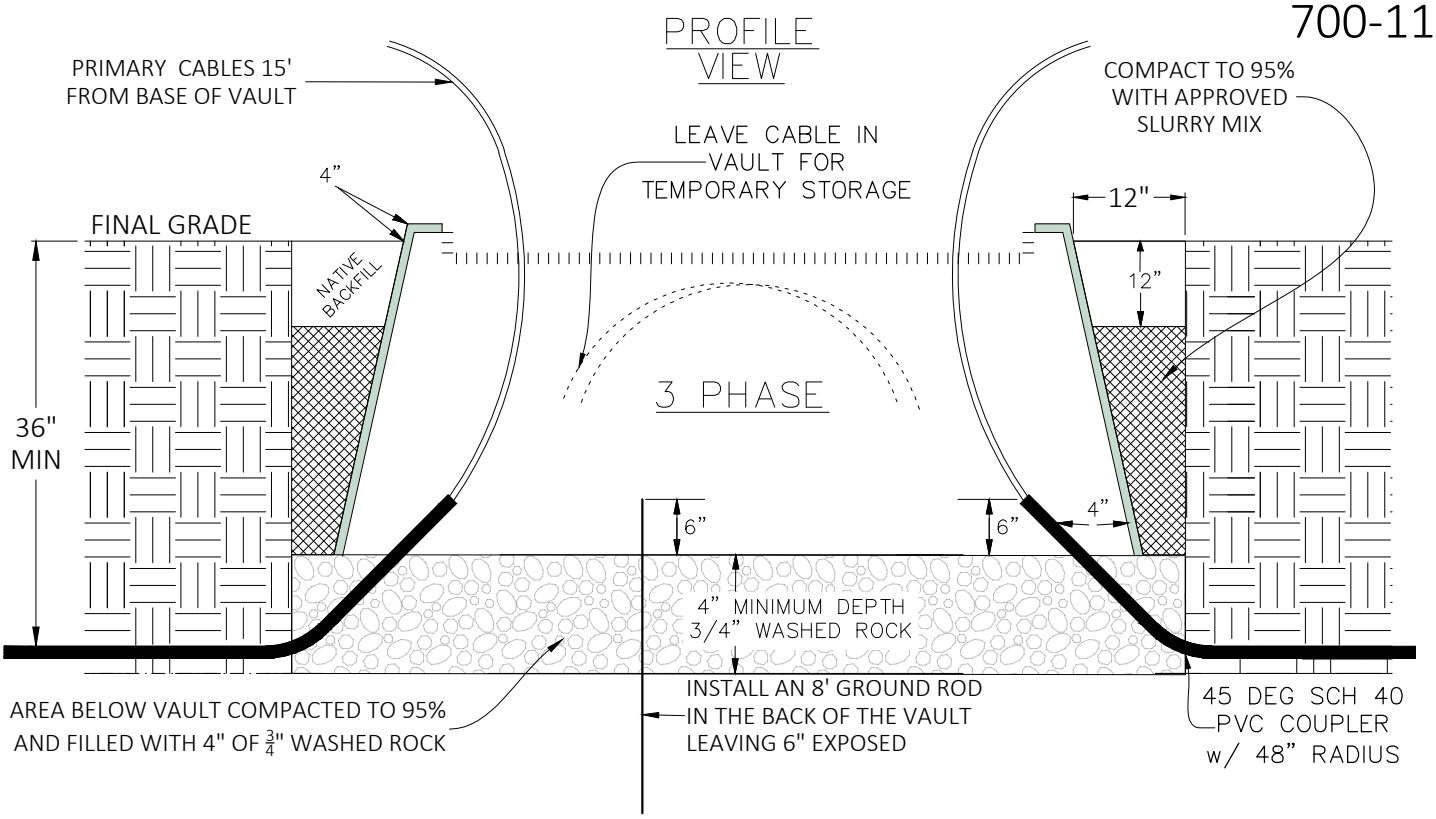

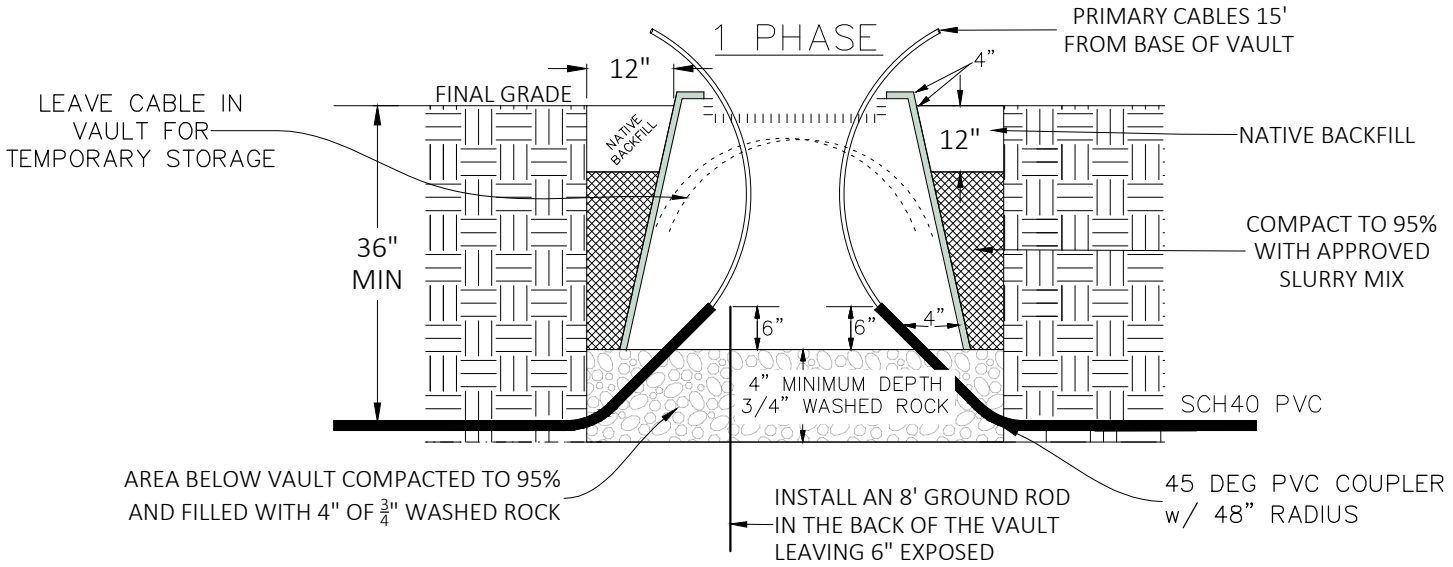

NOTES:

1. VAULT MUST BE LEVEL AND SET 4" ABOVE FINAL GRADE
2. PROVIDE 95% COMPACTION UNDER AND AROUND THE VAULT
3. MINIMUM OF 4" WASHED ROCK TO BE INSTALLED UNDER THE VAULT
4. CABLE LENGTH SHALL BE 15' AND MEASURED FROM THE BASE OF THE VAULT
5. THE CABLE DUCT SHALL HAVE 6" EXPOSED IN THE VAULT
6. USE 45 DEG COUPLERS w/ 48 IN RADIUS TO SWEEP THE PRIMARY PVC CONDUITS INTO THE VAULT
7. AN 8' GROUND ROD SHALL BE PLACED IN THE BACK OF THE VAULT OPENING LEAVING 6" EXPOSED ABOVE THE ROCK
8. REFER TO DETAIL 700-02 FOR MINIMUM CLEARANCE REQUIREMENTS

ELECTRIC SERVICES | CALL 1-800-922-1987 TO OBTAIN UTILITY LOCATES | NOT TO SCALE

CITY OF LONGMONT COLORADO

PRIMARY JUNCTION VAULT

Revision #:	
Approved by:	
Date Approved:	
File: UG Drawings 2025	
DETAIL	
700-11	

1100 S SHERMAN ST
LONGMONT, CO 80501
PHONE: 303-651-8386
FAX: 303-651-8796